




120-1

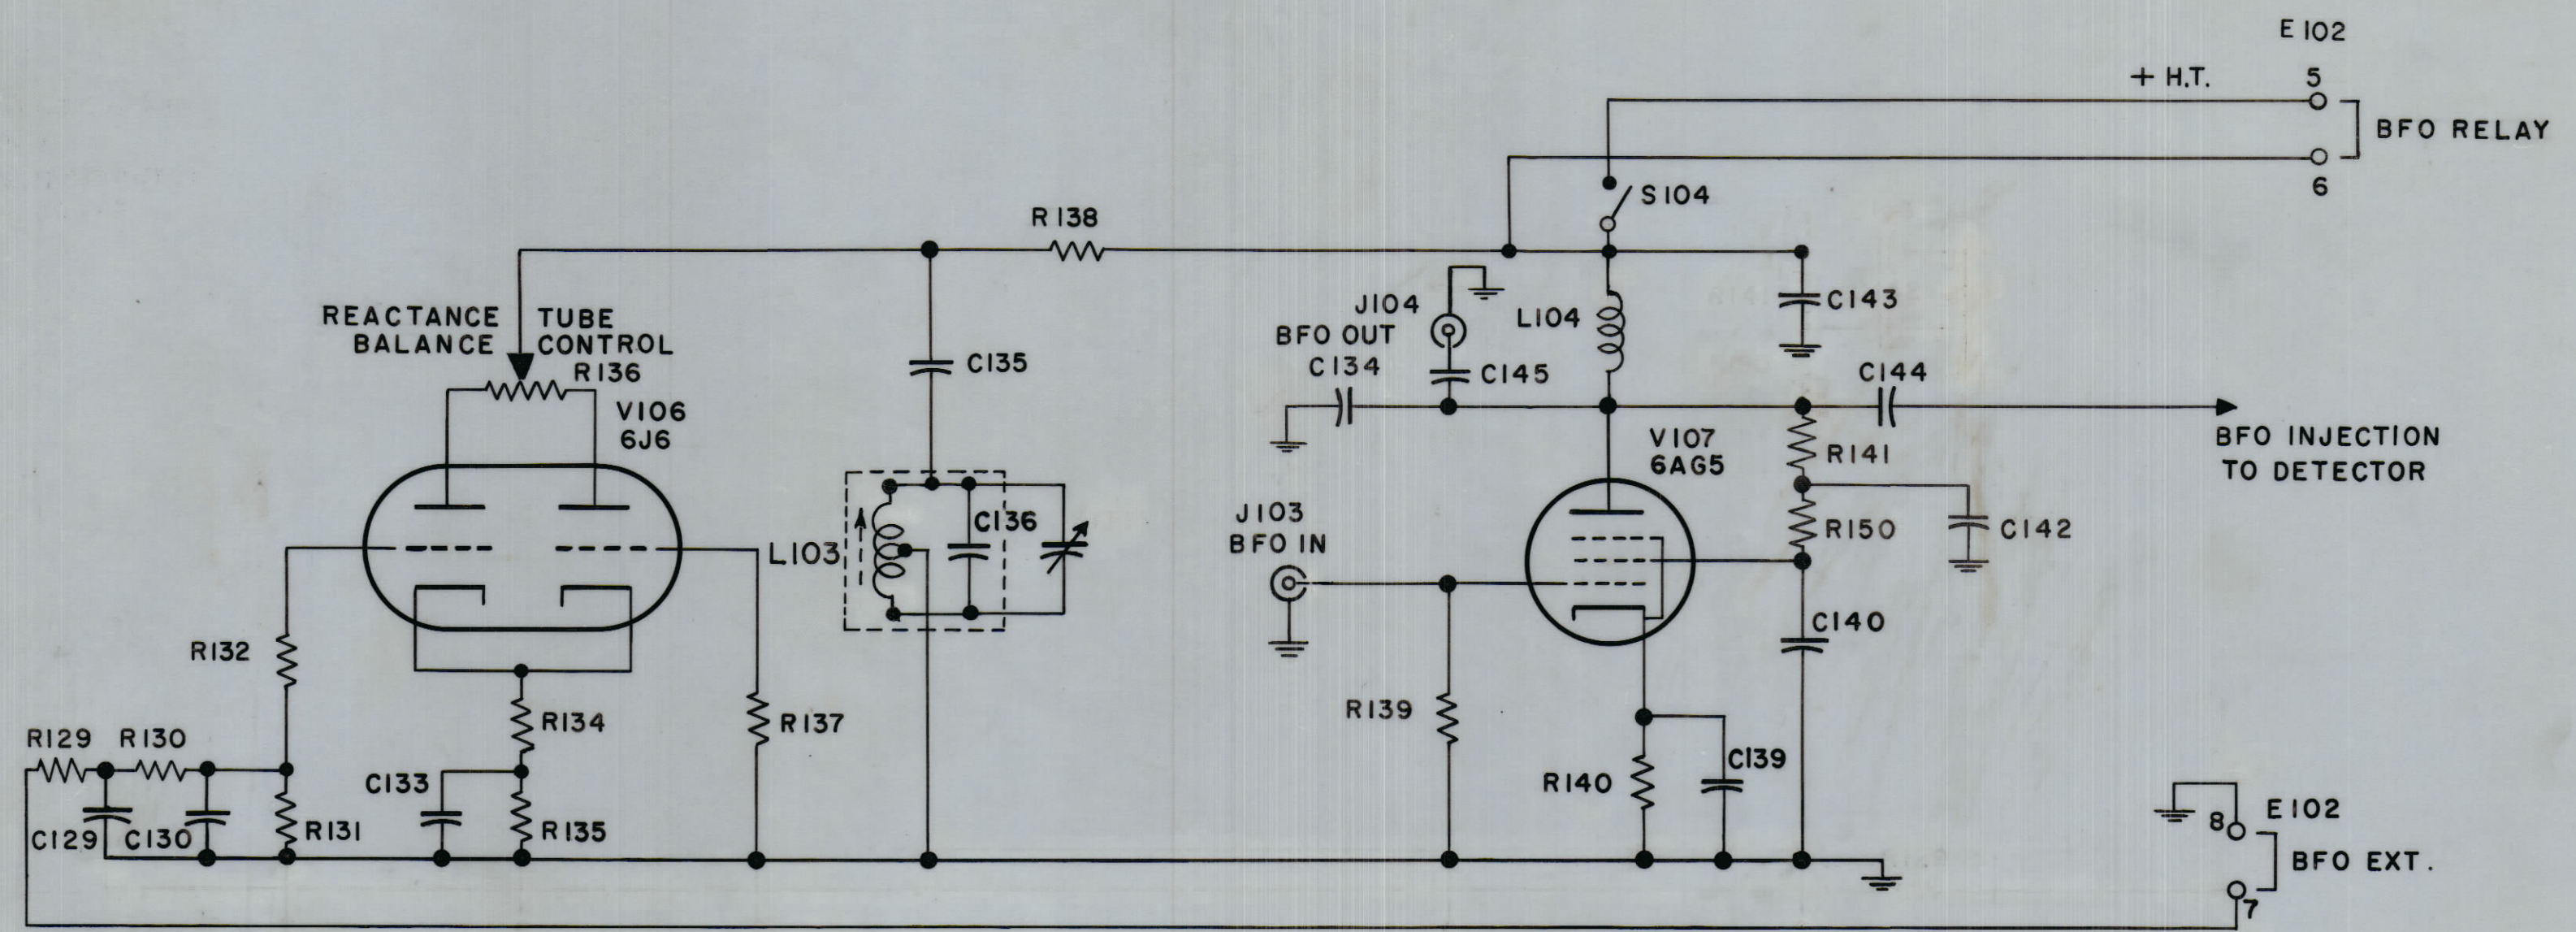

SIMPLIFIED BFO & BFO REACTANCE CIRCUIT S103 IN POSITION 1. (EXT-SLAVE)

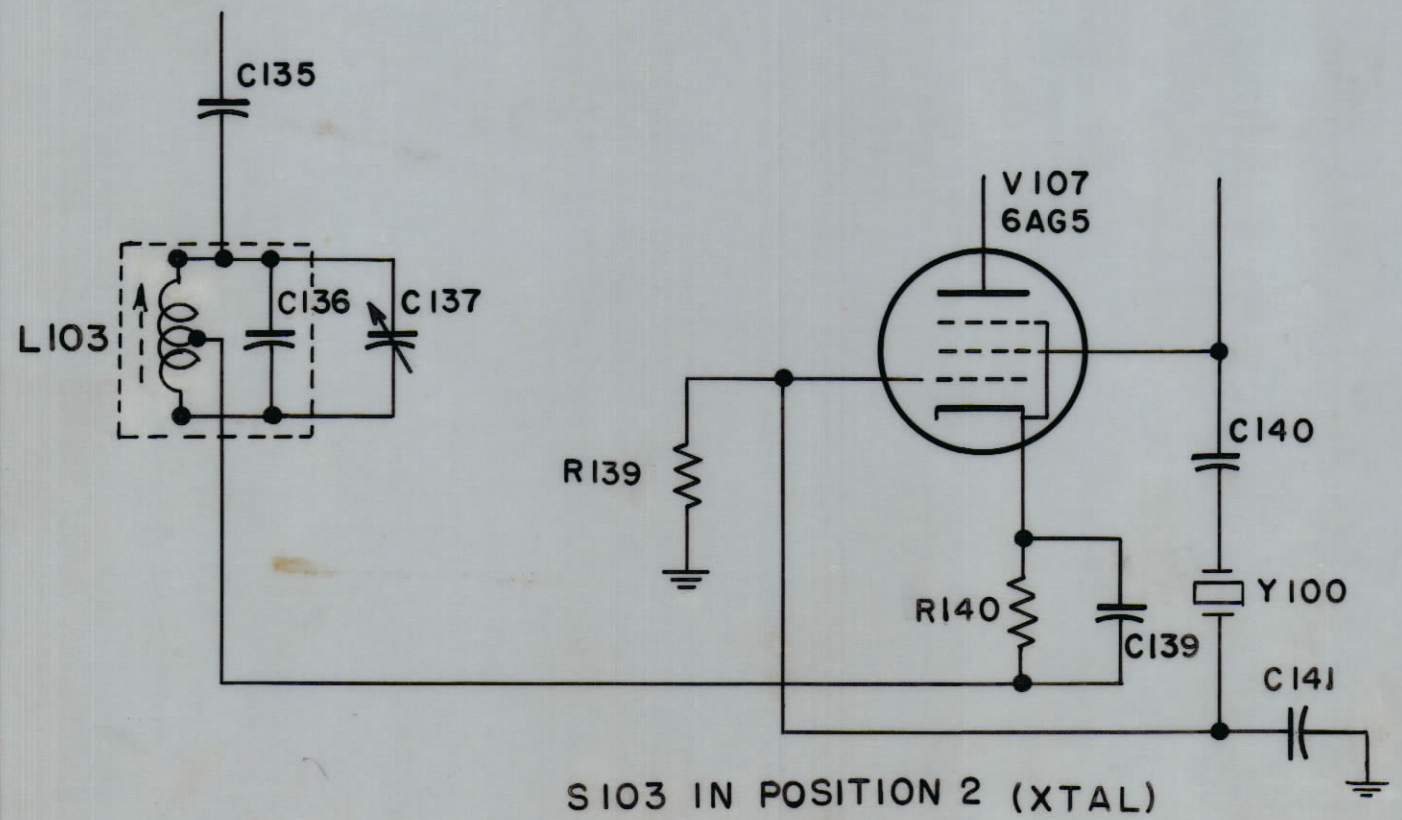

S103 IN POSITION 2 (XTAL)

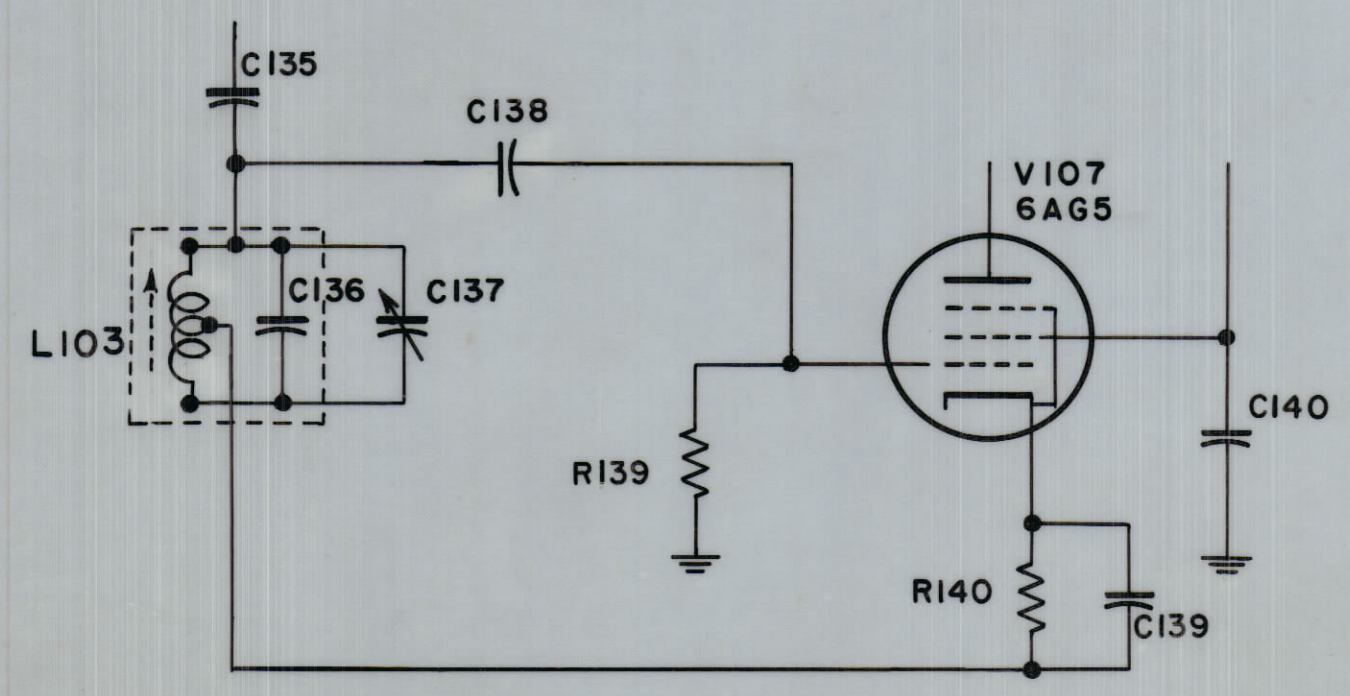

S103 IN POSITION 3 (BFO)

@55

SIMPLIFIED DIAGRAM BFO & BFO REACTANCE CT. RECEIVER AN/FRR-502

CK-10049A

CHECKED : APPROVED : DATE: JULY 8, 1955

FIG 2-8

CK 10049A